


LIST OF MATERIAL

ITEM	DESCRIPTION
①	SR 90° BEND, D.I., FLG X FLG., CLASS 250
②	RESILIENT WEDGE VALVE, O.S.&Y., FLG X FLG, HAND WHEEL.
③	RPP BACKFLOW PREVENTER, CLA-VAL. CO MODEL RP-1 OR APPROVED EQUAL.
④	SUPPORT, ADJUSTABLE PIPE, FLAT SUPPORT (SEE STD. W-18).
⑤	STEEL RISER PIPE, SCHEDULE 40 MINIMUM, DIAMETER CONSISTENT WITH MAINLINE.

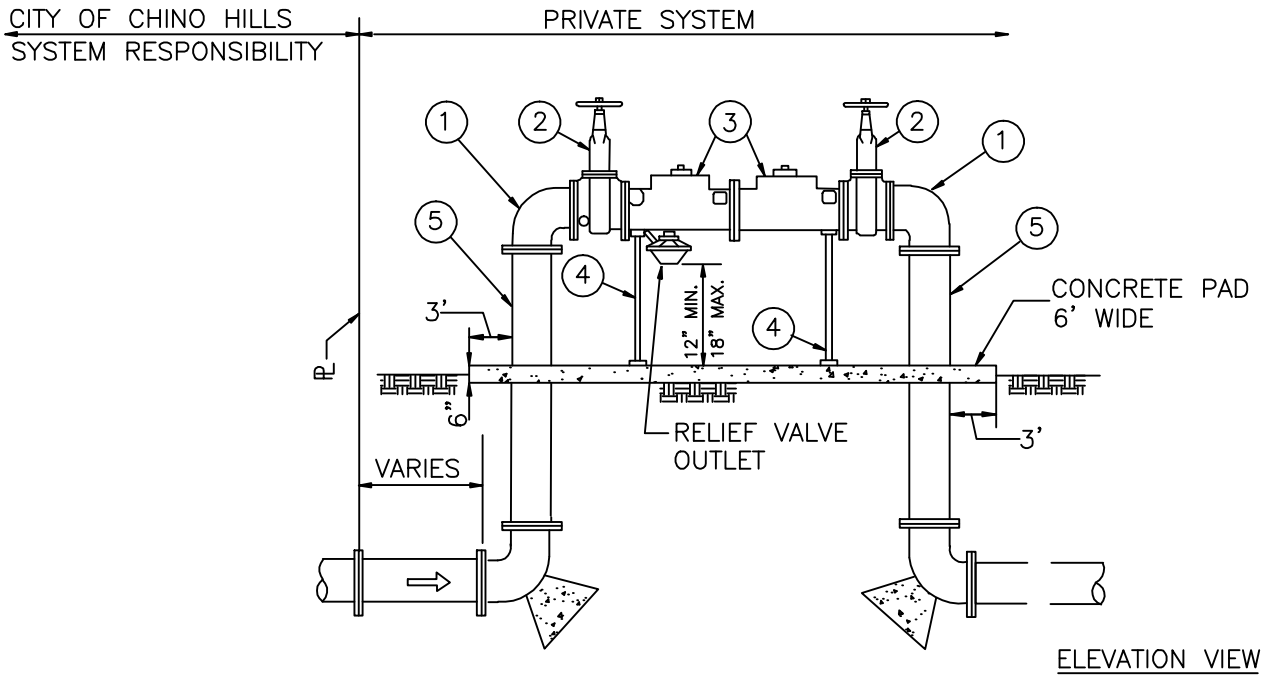

NOTES:

- O.S.&Y. VALVES SHALL BE LOCKED IN OPEN POSITION WITH CHAIN AND OWNER'S PADLOCK(S) IN SERIES.
- ALL ADAPTORS, BENDS, AND SPOOLS SHALL COMPLY WITH PART 3, SECTIONS 2-07 THROUGH 2-10 OF THESE SPECIFICATIONS.
- THE COMPLETED ASSEMBLY SHALL BE PAINTED PER PART 3, SECTION 2-13.
- ASSEMBLY TO BE SCREENED PER W-26.
- NO FIRE DEPARTMENT CONNECTIONS ARE ALLOWED TO BE PLACED ON THE ASSEMBLY.

AUGUST 2005

CITY OF CHINO HILLS		3" AND LARGER REDUCED PRESSURE DETECTOR ASSEMBLY	W-14
Revised: / / by:	Approved by:		
Revised: / / by:	CITY ENGINEER		